



**Monitoring report form for CDM project activity
(Version 06.0)**

MONITORING REPORT

Title of the project activity	Small-Scale Hydropower Project Sahanivotry in Madagascar	
UNFCCC reference number of the project activity	3558	
Version number of the PDD applicable to this monitoring report	4.3	
Version number of this monitoring report	1	
Completion date of this monitoring report	15/09/2017	
Monitoring period number	4 th monitoring period	
Duration of this monitoring period	01/06/2016 – 31/08/2017	
Monitoring report number for this monitoring report	n/a	
Project participants	HYDELEC Madagascar SA	
Host Party	Madagascar	
Sectoral scopes	Sectoral scope 01: Energy industries (renewable - / non-renewable sources)	
Applied methodologies and standardized baselines	ACM0002 “Consolidated baseline methodology for grid-connected electricity generation from renewable sources” (version 13.0.0)	
Amount of GHG emission reductions or net anthropogenic GHG removals achieved by the project activity in this monitoring period	Amount achieved before 1 January 2013	Amount achieved from 1 January 2013
	-	42,728
Amount of GHG emission reductions or net anthropogenic GHG removals estimated ex ante for this monitoring period in the PDD	55,245	

SECTION A. Description of project activity

A.1. General description of project activity

The purpose of the Sahanivotry Hydro Power Plant (hereafter referred to as "SHPP") is to generate renewable energy using clean hydropower and sell the output electricity into the regional grid of Antananarivo (hereafter referred to as RI TANA) operated by JIRAMA.

SHPP is a run-of-river hydropower plant with a capacity of 16.5 MW with an average electricity generation of 80 GWh (up to 90 GWh in optimal years). The project uses three new Pelton turbines and three new generators provided by Hunan Lingling Hengyuan Generating Equipment Co., Ltd (China).

The project construction was commenced in March 2007, and the hydropower plant started commercial operation in October 2008.

The project has been implemented according to the following time schedule:

Table 1 – Time schedule of project implementation

Nr	Milestones	Key Dates
1	Authorization	02/2001-11/2007
1.1	Concession for the installation and operation of SHPP with an installed capacity of 10 MW Issuing Authority: Ministry of Energy and Mines (MEM)	17/02/2001
1.2	Approbation of the concession contract for the production of energy at HPP with an installed capacity of 10 MW Issuing Authority: MEM	23/03/2001
1.3	Authorisation for starting construction and increasing capacity from 10 to 15 MW Issuing Authority: MEM	07/03/2007
1.4	Authorization for the increase of capacity by 5 MW at SHPP. Issuing authority: MEM	28/11/2007
2	Power Purchase Agreement with Jirama	02/2001-08/2007
2.1	Signature of Power Purchase Agreement (PPA)	17/02/2001
2.2	PPA amendment Nr. 1	27/06/2001
2.3	PPA amendment Nr. 2	12/10/2006
2.4	PPA amendment Nr. 3	16/08/2007
3	Financing	07-09/2007
3.1	Loan Agreement with African Development Bank (AfDB)	05/07/2007
3.2	Loan Agreement with BFV-Société Générale and Mauritius Commercial Bank (Madagascar) S.A.	06/09/2007
4	Construction	03/2007-09/2008
4.1	Start of construction	03/2007
4.2	Procurement and installation of HPP	05-09/2008
5	Start operation	01/10/2008

Due to the fact that SHPP was registered under CDM only on 28/08/2010, the CDM crediting period starts with the CDM registration date. As a result of exporting renewable energy to the fossil fuel intensive national grid, the accrued emission reductions from June 1st, 2016 until August 31st, 2017, amounted to 42,728 tCO₂.

A.2. Location of project activity

The project is located about 30 km from Antsirabé on the river Ampamehana within Sahanivotry village, Antananarivo Province, Madagascar. The Ministry of Energy granted to HYDELEC for a period of 30 years the right to use 70 ha of land that belongs to Sahanivotry village for the construction and operation of the SHPP. The geographical co-ordinates of the project are 47°08' East (longitude) and 20°12' South (latitude).



Figure 1 – The project location

A.3. Parties and project participants

Parties involved	Project participants	Indicate if the Party involved wishes to be considered as project participant (Yes/No)
Madagascar (host)	HYDELEC Madagascar SA (Private Entity)	No

A.4. Reference to applied methodologies and standardized baselines

The baseline and monitoring methodology ACM0002 “Consolidated baseline methodology for grid-connected electricity generation from renewable sources” (version 13.0.0 EB 67) is applied to the project activity.

In line with the application of the ACM0002 methodology, the project refers to the following tools:

- “Tool to calculate the emission factor for an electricity system” (version 03.0.0 EB 70),
- “Tool for the demonstration and assessment of additionality” (version 07.0.0 EB 70),
- “Tool to calculate project or leakage CO₂ emissions from fossil fuel combustion” (version 02 EB 41).

A.5. Crediting period type and duration

The fixed CDM crediting period is from 28/08/2010 (date of CDM registration) to 27/08/2020.

SECTION B. Implementation of project activity**B.1. Description of implemented project activity**

The project construction was commenced in March 2007, and the hydropower plant started commercial operation in October 2008 based on the following technical specifications, as per registered PDD.

Table 2 – Installed equipment characteristics

Turbines	Manufacturer	Model	Type	Rated Power	Rated head	Rated flow
3	Hunan Lingling Hengyuan Generating Equipment Co., Ltd (China)	CJA237-W-140/2x18	Pelton	5,676 kW	210 m	3.12m ³ /s
Generator	Manufacturer	Model	Type	Rated Power	Rated voltage	Rated rotation speed
3	Hunan Lingling Hengyuan Generating Equipment Co., Ltd (China)	SFW5500-14/2420	-	5.5 MW	6.3 kV	428.6 r/min

During this monitoring period, the project has operated continuously and satisfactorily, with the exception of the following event:

- From April 24th to April 26th of 2017, the power meters froze following a network perturbation. While the power plant kept working normally during this period, its power production was conservatively not accounted for emission reductions calculation.

No other relevant events or situations have been reported during the monitoring period. Regular maintenance is undertaken unit after unit in order to minimize impacts on overall continuous production, according to maintenance schedule. Routine sand removal operations take place up to twice or thrice a month during rainy season, for short durations of 8 to 10 hours only, usually conducted in parallel of JIRAMA grid maintenance.

No legislation change occurred in Madagascar since the Concession Agreement with Ministry of Energy and the Power Purchase Agreement with JIRAMA were signed.

B.2. Post-registration changes**B.2.1. Temporary deviations from the registered monitoring plan, applied methodologies or standardized baselines**

N/A

B.2.2. Corrections

N/A

B.2.3. Changes to the start date of the crediting period

N/A

B.2.4. Inclusion of monitoring plan

N/A

B.2.5. Permanent changes to the registered monitoring plan, or permanent deviation of monitoring from the applied methodologies, standardized baselines, or other applied standards or tools

A post-registration changes was undertaken during 1st monitoring period (reference PRC-3558-001 approved on Nov 12, 2013); no other changes occurred subsequently.

B.2.6. Changes to project design

A post-registration changes was undertaken during 1st monitoring period (reference PRC-3558-001 approved on Nov 12, 2013); no other changes occurred subsequently.

SECTION C. Description of monitoring system

The data to be monitored is the net electricity supplied to the regional grid and any diesel consumed by the emergency back-up diesel generator.

Energy meters

Two bi-directional energy meters M1 and M2 (ACTARIS SL 7000 Type SL 761 B/C 060 manufactured by ACTARIS France with a respective accuracy of 0.5% and 1%) have been installed for monitoring the generated power, according to the national practice set by JIRAMA.

The meters register the following information:

- Active power
- Reactive power
- Apparent power
- Voltage
- Phase's current
- Active energy
- Frequency
- Event record
- Harmonics

The electricity delivered from SHPP to the regional grid is thus continuously monitored through these metering equipments installed at project site, two bi-directional electricity meters M1 and M2:

Table 3 – Electricity meters characteristics

Meters label	Serial Number	Characteristics	Accuracy	Use
M1 (<i>main</i>)	33055428	bi-directional	0,5 %	Monitoring of net electricity supplied by the project
M2 (<i>back-up</i>)	36050447	bi-directional	1 %	Used in case of failure of M1

M1 (and M2 backup) readings are measured thanks to bi-directional meters, allowing to deduct SHPP's eventual power import from the grid for its auxiliary consumption when not operational (and alternatively to its emergency diesel generator). Billing is then processed under a monthly invoice from Hydec to JIRAMA based on measurements of electricity exported, double-checked by JIRAMA headquarters and Antsirabe sub-station before payment.

Table below provides indicative information along monitoring period regarding activities/observation/measures taken for monitoring energy generated by the project mentioning with which meter information has been collected.

Table 4 – Monitoring events

<i>Period</i>	<i>Activities</i>	<i>Observations/Measures taken</i>
01.06.2016 to 23.04.2017	M1 and M2 in function	Data collection from M1
24.04.2017 to 26.04.2017	M1 and M2 out-of-work following a network perturbation	Power generation conservatively excluded from ER calculation
27.04.2017 to 31.08.2017	M1 and M2 in function	Data collection from M1

The following grid connection diagram indicates the principles of positioning of metering instruments that have been used in the monitoring of the emission reductions. Staff record the operation status and reading of metering equipments daily on site (6:00 am), which log-sheet of production recorded daily is provided to DOE. Furthermore, designated staff collect the measured electricity weekly before it is checked by the company administrator or supervisor regularly.

Two additional meters M3 (n°36050437 at Antsirabe sub-station) and M4 (n°73305393 at Holcim Ibity cement factory) are used by JIRAMA as a cross-check at Antsirabe's substation and Ibity end-user connection.

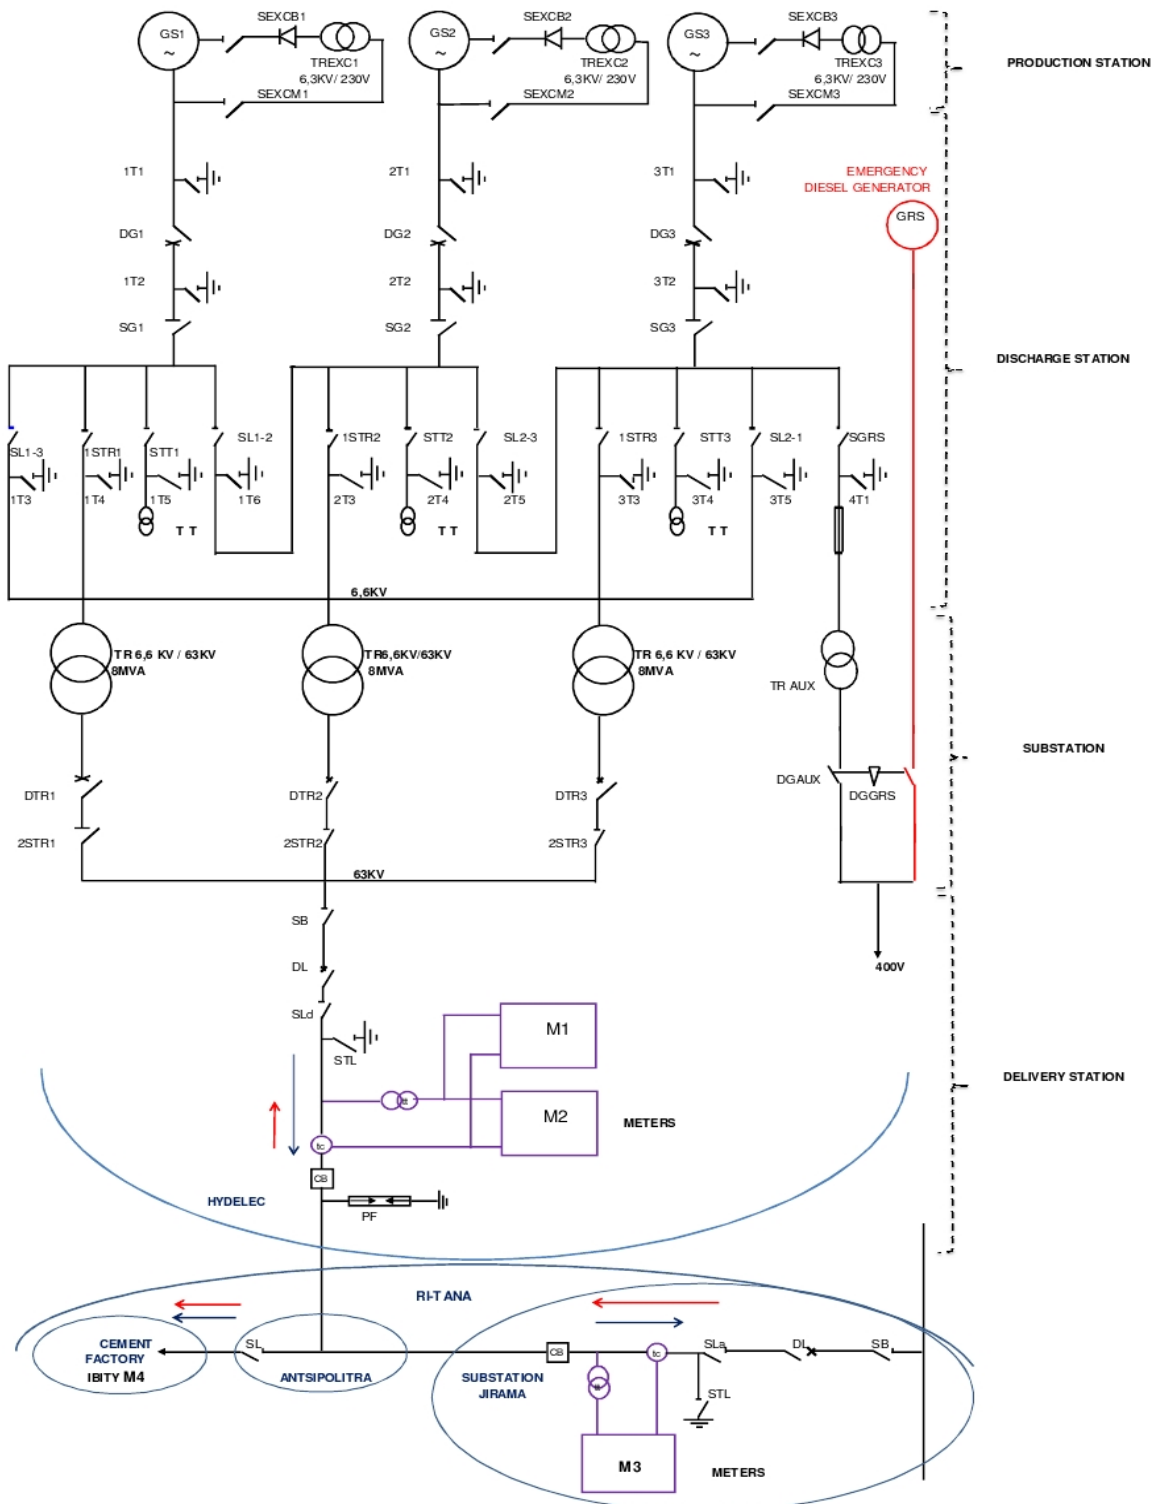


Figure 2 – Grid connection and meters diagram

- | | |
|---|---|
| <p>SEXCB :low voltage excitation disconnector
 SEXCM :Medium voltage excitation disconnector
 TREXC :excitation transformer
 DG :generator's circuit breaker
 SG :generator's disconnector
 CB :tank circuit
 STR: transformer's disconnector
 DTR:transformer's circuit breaker
 STT:voltage transformer's disconnector
 SL: link disconnector
 ST: earthing switch
 TRAUX : auxiliary transformer
 DGAUX:auxiliary circuit breaker
 DGGRS: emergency generator circuit breaker
 TT:voltage transformer</p> | <p>SB: bus bar disconnector
 DL: line's circuit breaker
 GS: generator
 SGRS: emergency diesel generator's disconnector
 STL: line's earthing switch
 SLa: line's disconnector
 SLd: line's disconnector
 M1,M2,M3, M4: kilowatt-hour meters
 tc: current transformer
 tt: voltage transformer
 PF: surge arrester</p> |
|---|---|


current direction when the plant is operational
 current direction when the plant is shutdown

During any emergency or maintenance situation, and if back-up electricity is not available from the grid, the quantity of diesel fuel consumed by the diesel generator is measured and recorded in a log book.

The project owner HYDELEC took the responsibility of the monitoring plan implementation; HYDELEC appointed a CDM manager, who is responsible for the supervision of the monitoring process, the data measuring, collection and recording, QA/QC, audit and reporting.

The staff from technical and financial departments undertook the monitoring tasks including control of metering equipments periodically, collecting electricity data and completing records, checking and analyzing the data, archiving relevant records, reporting to the CDM manager.

Figure 3 – Monitoring and management structure

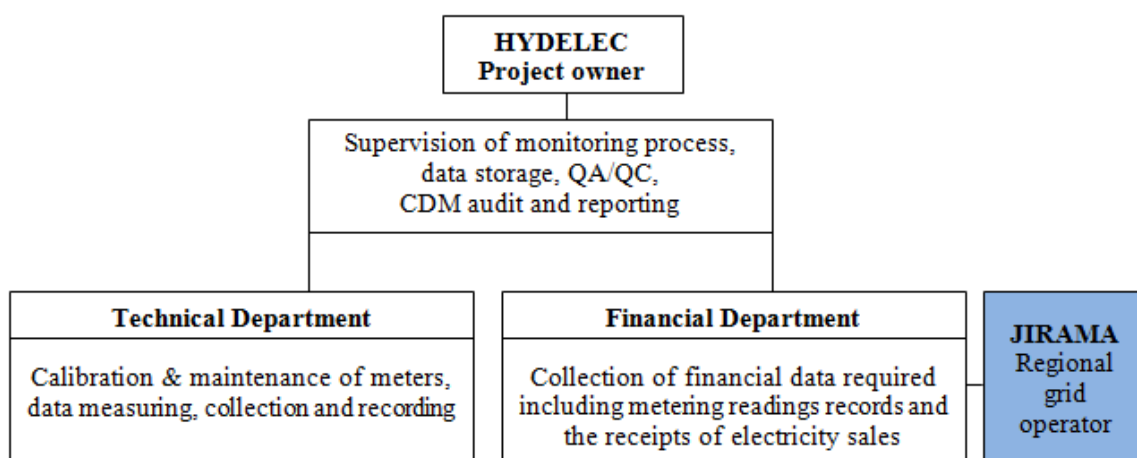

Quality assurance and quality control

The electricity delivered by SHPP to RI TANA is monitored through metering equipment at the project site and invoiced monthly to JIRAMA. The data is cross-checked for quality control against electricity transmission records from JIRAMA dispatching department twice (at Antsirabe and at RI-Tana headquarter) before approval of the billing.

Calibration of meters occurs annually according to the national practice set by JIRAMA. All relevant data records obtained from the monitoring are kept by the project owner during the crediting period and for at least two years after the end of crediting period.

Operational procedures, including emergency response and troubleshooting measures, are described in the implemented manuals (provided to the DOE) based on which the project staff is trained:

- Exploitation procedures manual (*Manuel de Procédures d'Exploitation*)
- CDM monitoring manual
- Quality management manual

SECTION D. Data and parameters

D.1. Data and parameters fixed ex ante

Data/parameter:	$FC_{i,m,y}$
Unit	g/kWh

Description	Amount of fossil fuel type i consumed by power plant / unit m in year y within RI TANA
Source of data	JIRAMA (2007) Ministry of Energy and Mines, Least Cost Generation Master plan (2005)
Value(s) applied)	See Annex 3 of registered PDD
Choice of data or measurement methods and procedures	The data is from the national utility JIRAMA resp. Ministry of Energy and Mines.
Purpose of data/parameter	Calculation of baseline emissions
Additional comments	The uncertainty of the data is low.

Data/parameter:	EG_{m,y} and EG_{k,y}
Unit	MWh
Description	Net electricity generated and delivered to the RI TANA by power plant / unit m resp. k in year y
Source of data	JIRAMA (2004, 2005, 2006)
Value(s) applied)	See Annex 3 of registered PDD
Choice of data or measurement methods and procedures	The data is from the national utility JIRAMA resp. Ministry of Energy and Mines.
Purpose of data/parameter	Calculation of baseline emissions
Additional comments	The uncertainty of the data is low.

Data/parameter:	NCV_{i,y}
Unit	GJ/ton
Description	Net calorific value (energy content) of fossil fuel type i in year y
Source of data	2006 IPCC Guidelines for National Greenhouse Gas Inventories
Value(s) applied)	Fuel oil: 44.44 Diesel: 40.19
Choice of data or measurement methods and procedures	2006 IPCC Guidelines for National Greenhouse Gas Inventories are considered to be authoritative.
Purpose of data/parameter	Calculation of baseline emissions
Additional comments	-

Data/parameter:	EF_{CO₂,i,j,y}
Unit	tCO ₂ /GJ
Description	CO ₂ emission factor of fossil fuel type i in year y
Source of data	2006 IPCC Guidelines for National Greenhouse Gas Inventories. Workbook Vol.2.
Value(s) applied)	Fuel oil: 77.37 Diesel: 74.06
Choice of data or measurement methods and procedures	IPCC Guidelines for National Greenhouse Gas Inventories are considered to be authoritative.
Purpose of data/parameter	Calculation of baseline emissions
Additional comments	-

Data/parameter:	λ_y
Unit	%

Description	Fraction of time when the low-cost must-run resources are on the margin in year y
Source of data	JIRAMA (2007)
Value(s) applied)	74
Choice of data or measurement methods and procedures	The data is from the national utility JIRAMA.
Purpose of data/parameter	Calculation of baseline emissions
Additional comments	The uncertainty of the data is low.

Data/parameter:	EF_{CO2} for the diesel consumed by the emergency back-up diesel generator
Unit	tCO ₂ /kg of diesel
Description	CO ₂ emission factor of diesel used for the emergency back-up diesel generator at SHPP
Source of data	Footnote of Table I.D.1 in AMS I.D. ver.13 mentions this conversion factor following revised 1996 IPCC Guidelines for National Greenhouse Gas Inventories.
Value(s) applied)	3.2 tCO ₂ /kg of diesel
Choice of data or measurement methods and procedures	Default value
Purpose of data/parameter	Calculation of baseline emissions
Additional comments	-

Data/parameter:	CAP_{BL}
Unit	W
Description	Installed capacity of the hydro power plant before the implementation of the project activity.
Source of data	Project site
Value(s) applied)	For new hydro power plants, this value is zero.
Choice of data or measurement methods and procedures	-
Purpose of data/parameter	Calculation of baseline emissions
Additional comments	This parameter is used to calculate the power density. However calculation of power density is not required for this proposed project activity (no reservoir).

Data/parameter:	ABL
Unit	m ²
Description	Area of the reservoir measured in the surface of the water before the implementation of the project activity, when the reservoir is full
Source of data	Project site
Value(s) applied)	For new reservoirs, this value is zero
Choice of data or measurement methods and procedures	-
Purpose of data/parameter	Calculation of baseline emissions
Additional comments	This parameter is used to calculate the power density. However calculation of power density is not required for this proposed project activity (no reservoir).

D.2. Data and parameters monitored

Data/parameter:	EG_{facility,y}																			
Unit	MWh/yr																			
Description	Quantity of net electricity generation supplied by the project plant to the grid in year y																			
Measured/calculated/default	Measured																			
Source of data	Energy production records																			
Value(s) of monitored parameter	<table border="1"> <thead> <tr> <th>y</th> <th>2016</th> <th>2017</th> <th>Total</th> </tr> </thead> <tbody> <tr> <td>EG_{facility,y}</td> <td>29,021</td> <td>48,965</td> <td>77,986</td> </tr> </tbody> </table>				y	2016	2017	Total	EG _{facility,y}	29,021	48,965	77,986								
y	2016	2017	Total																	
EG _{facility,y}	29,021	48,965	77,986																	
Monitoring equipment	<p>Two bi-directional energy meters M1 (main) and M2 (back-up) are used to monitor the net electricity generated (ACTARIS SL 7000 Type SL 761 B/C 060; Serial number: 33055428 and 36050447; Manufactured by ACTARIS France with a respective accuracy of 0.5% and 1%).</p> <p>M1 and M2 are installed on the 63 kV substation of the hydro power plant to measure directly and continuously the electricity generation and the net electricity supply to the grid. The metering instruments M1 and M2 satisfy the accuracy class requirements as per Article 05 of original Power Purchase Agreement dated 17/02/2001 and have been calibrated on-site annually by JIRAMA in accordance with the national practice set by JIRAMA PPA and 16/08/2007 amendment about ownership and maintenance:</p> <p>Table 5 - calibration events</p> <table border="1"> <thead> <tr> <th>Calibration events</th> <th>Validity</th> <th>Delayed calibration?</th> <th>Comment</th> </tr> </thead> <tbody> <tr> <td>(24/03/2015)</td> <td>23/03/2016</td> <td>Yes, until 08/08/2016</td> <td>Calibration of both meters</td> </tr> <tr> <td>08/08/2016</td> <td>07/08/2017</td> <td>No</td> <td>Calibration of both meters</td> </tr> <tr> <td>27/04/2017</td> <td>26/04/2018</td> <td>No</td> <td>Calibration of both meters</td> </tr> </tbody> </table> <p>Both meters are always checked & calibrated together. During this third monitoring period, M1 & M2 were properly calibrated except for the period spanning from 01/06/2016 to 08/08/2016 when delayed calibration occurred (see calculation below).</p>				Calibration events	Validity	Delayed calibration?	Comment	(24/03/2015)	23/03/2016	Yes, until 08/08/2016	Calibration of both meters	08/08/2016	07/08/2017	No	Calibration of both meters	27/04/2017	26/04/2018	No	Calibration of both meters
Calibration events	Validity	Delayed calibration?	Comment																	
(24/03/2015)	23/03/2016	Yes, until 08/08/2016	Calibration of both meters																	
08/08/2016	07/08/2017	No	Calibration of both meters																	
27/04/2017	26/04/2018	No	Calibration of both meters																	
Measuring/reading/recording frequency:	Measured continuously, recorded daily and aggregated monthly																			
Calculation method (if applicable):	<p>The un-calibrated measurement period has been adjusted by deducting (respectively adding) the accuracy range of meters M1 and M2 from their export (respectively imports) readings:</p> <table border="1"> <thead> <tr> <th>Delayed calibration period</th> <th>Uncalibrated metered data (kWh)</th> <th>Applicable accuracy deduction</th> <th>Adjusted data for ER calculation (kWh)</th> </tr> </thead> <tbody> <tr> <td>01/06/2016 to 08/08/2016 (M1)</td> <td>Exports: 17,856.87 Imports: 0.191 EG_{facility,y}: 17,856.68</td> <td>0,5%</td> <td>Exports: 17,767.59 Imports: 0.192 EG_{facility,y}: 17,767.40</td> </tr> </tbody> </table>				Delayed calibration period	Uncalibrated metered data (kWh)	Applicable accuracy deduction	Adjusted data for ER calculation (kWh)	01/06/2016 to 08/08/2016 (M1)	Exports: 17,856.87 Imports: 0.191 EG _{facility,y} : 17,856.68	0,5%	Exports: 17,767.59 Imports: 0.192 EG _{facility,y} : 17,767.40								
Delayed calibration period	Uncalibrated metered data (kWh)	Applicable accuracy deduction	Adjusted data for ER calculation (kWh)																	
01/06/2016 to 08/08/2016 (M1)	Exports: 17,856.87 Imports: 0.191 EG _{facility,y} : 17,856.68	0,5%	Exports: 17,767.59 Imports: 0.192 EG _{facility,y} : 17,767.40																	
QA/QC procedures:	<p>The electricity delivered by SHPP to RI TANA is monitored through metering equipment M1 (main) and M2 (back-up) at the project site, with a respective accuracy of 0.5% and 1%, and invoiced monthly to JIRAMA. The data is cross-checked for quality control against electricity transmission records from JIRAMA dispatching department twice (at Antsirabe and at RI-Tana headquarter) before approval of the billing. Billing is then processed under a monthly invoice from Hydelec to JIRAMA based on measurements of electricity supplied.</p>																			

Purpose of data/parameter:	Calculation of baseline emissions
Additional comments:	In business-as-usual conditions, when both meters are operational, M1 is used for metering, and M2 in case of failure.

Data/parameter:	FC_{diesel}
Unit	kg
Description	The quantity of diesel fuel consumed by the diesel generator during any emergency situation
Measured/calculated/default	Calculated
Source of data	The emergency records and log book
Value(s) of monitored parameter	700
Monitoring equipment	-
Measuring/reading/recording frequency:	-
Calculation method (if applicable):	The total diesel consumption in volume, recorded from tank gauge readings, was converted into kilogram based on a highly conservative density value of 1 kg/L.
QA/QC procedures:	This is cross checked with the purchase receipts of diesel fuel and measurement conducted in the diesel storage tank.
Purpose of data/parameter:	Calculation of project emissions
Additional comments:	The diesel generator only operates in unplanned emergency situations. The hydropower plant has three turbines; therefore the maintenance is done during the dry season; where only one or two turbines are running. That means the maintenance of SHPP is done without any need of the diesel generator.

Data/parameter:	NCV_{diesel,y}
Unit	GJ per mass or volume unit (e.g. GJ/m ³ , GJ/ton)
Description	Weighted average net calorific value of diesel fuel in year y
Measured/calculated/default	Default
Source of data	IPCC default values at the upper limit of the uncertainty at a 95% confidence interval as provided in Table 1.2 of Chapter 1 of Vol. 2 (Energy) of the 2006 IPCC Guidelines on National GHG inventories, as neither local nor national values available.
Value(s) of monitored parameter	43.3
Monitoring equipment	-
Measuring/reading/recording frequency:	-
Calculation method (if applicable):	-
QA/QC procedures:	-
Purpose of data/parameter:	Calculation of project emissions
Additional comments:	No revision of the IPCC Guidelines have been done thus not taken into account.

Data/parameter:	EF_{CO₂, diesel,y}
Unit	tCO ₂ /GJ
Description	Weighted average CO ₂ emission factor of diesel fuel in year y
Measured/calculated/default	Default

Source of data	IPCC default values at the upper limit of the uncertainty at a 95% confidence interval as provided in Table 1.4 of Chapter 1 of Vol. 2 (Energy) of the 2006 IPCC Guidelines on National GHG Inventories, as neither local nor national values available.
Value(s) of monitored parameter	0.0748
Monitoring equipment	-
Measuring/reading/recording frequency:	-
Calculation method (if applicable):	-
QA/QC procedures:	-
Purpose of data/parameter:	Calculation of project emissions
Additional comments:	Applicable since Option B of the Tool to calculate project or leakage CO ₂ emissions from fossil fuel combustion is used. Any future revision of the IPCC Guidelines should be taken into account however no revision have been done at the time of project verification.

Data/parameter:	CAP_{PJ}
Unit	W
Description	Installed capacity of the hydro power plant after the implementation of the project activity
Measured/calculated/default	-
Source of data	Project site
Value(s) of monitored parameter	16,500,000
Monitoring equipment	-
Measuring/reading/recording frequency:	Monitored yearly
Calculation method (if applicable):	Determined based on recognized standards.
QA/QC procedures:	-
Purpose of data/parameter:	Applicability condition of methodology ACM0002
Additional comments:	This parameter is used to calculate the power density. However calculation of power density is not required for this proposed project activity. As mentioned in Applicability conditions of the methodology ACM0002, the project is the installation of a new run-off-river hydro power plant and does not involve any reservoir.

Data/parameter:	A_{PJ}
Unit	m ²
Description	Surface area of the reservoir measured at full supply level after the implementation of the project activity.
Measured/calculated/default	-
Source of data	-
Value(s) of monitored parameter	-
Monitoring equipment	-
Measuring/reading/recording frequency:	-
Calculation method (if applicable):	-
QA/QC procedures:	-

Purpose of data/parameter:	Applicability condition of methodology ACM0002
Additional comments:	This parameter is used to calculate the power density. However calculation of power density is not required for this proposed project activity. As mentioned in Table 4 (Applicability conditions of the methodology ACM0002), the project is the installation of a new run-off-river hydro power plant and does not involve any reservoir.

D.3. Implementation of sampling plan

No sampling plan is used thus section is not applicable.

SECTION E. Calculation of emission reductions or net anthropogenic removals

E.1. Calculation of baseline emissions or baseline net removals

Baseline emissions include only CO₂ emissions from electricity generation in fossil fuel fired power plants that are displaced due to the project activity. The methodology assumes that all project electricity generation above baseline levels would have been generated by existing grid-connected power plants and the addition of new grid-connected power plants. The baseline emissions are to be calculated as follows:

$$BE_y = EG_{PJ,y} \times EF_{grid,CM,y}$$

Where:

- BE_y = Baseline emissions in year y (tCO₂/yr)
 $EG_{PJ,y}$ = Quantity of net electricity generation that is produced and fed into the grid as a result of the implementation of the CDM project activity in year y (MWh/yr)
 $EF_{grid,CM,y}$ = Combined margin CO₂ emission factor for grid connected power generation in year y calculated using the latest version of the "Tool to calculate the emission factor for an electricity system" (tCO₂/MWh)

In this second monitoring period (01/06/2016 to 31/08/2017), the GHG baseline emissions was **42,728 tCO₂e** such as demonstrated in table below.

	EG_y (kWh)	EF_y (tCO ₂ e/MWh)	BE_y (tCO ₂ e)
jun-16	7 810 868	0,548	4 280
jul-16	5 926 952	0,548	3 247
aug-16	4 029 580	0,548	2 208
sep-16	2 539 879	0,548	1 391
oct-16	2 665 844	0,548	1 460
nov-16	2 770 332	0,548	1 518
dec-16	3 277 834	0,548	1 796
jan-17	5 473 008	0,548	2 999
feb-17	8 163 563	0,548	4 473
mar-17	9 482 878	0,548	5 196
apr-17	7 523 563	0,548	4 122
may-17	5 503 206	0,548	3 015
jun-17	5 148 733	0,548	2 821
jul-17	4 059 091	0,548	2 224
aug-17	3 611 075	0,548	1 978
Total	70 316 240		42 728

E.2. Calculation of project emissions or actual net removals

The only fossil CO₂ emissions from the project activity come from the 60 kVA diesel emergency unit installed at the plant (downsized from former 100 kVA gen-set replaced in December 2015). This unit is relied on only for unplanned emergency situations as the hydropower plant operates during 12 months per year. The hydropower plant has three turbines; therefore the maintenance is done during the dry season; where only one or two turbines were running. That means the maintenance is done easily without any need of the diesel generator.

The emergency system was only used to serve the plant when neither the power in the plant nor the grid power was available. Consequently, the back-up diesel generator operated for only 159 hours during the entire monitoring period, consuming 700 liters of diesel. Associated emissions have been conservatively calculated as less than 3 tCO₂ for the entire monitoring period, and confirmed as smaller than 1% of the total Emission Reductions by the DOE thus neglected:

$$PE_y = FC_{diesel,y} \times NCV_{diesel,y} \times EF_{CO_2, diesel,y}$$

Where

$FC_{diesel,y}$ = diesel consumed by the emergency back-up diesel generator in year y;

$NCV_{diesel,y}$ = weighted average net calorific value of diesel fuel in year y;

$EF_{CO_2, diesel,y}$ = weighted average CO₂ emission factor of diesel fuel in year ;

Period	FC _{diesel,y} (kg)	EF _{CO₂} (tCO ₂ e/kg)	PE _y (tCO ₂ e)	
	D	E	F=D*E	
01/06/2016 – 31/08/2017	700	0,0032	2,2	
Total	700		2,2	< 1% of total Emission Reductions thus neglected

E.3. Calculation of leakage emissions

As newly built hydropower plant, there is no energy generating equipment transferred from another activity and no existing equipment transferred to another activity. Therefore according to methodology ACM0002 there is no need to consider leakage (L_y) for the proposed project, thus L_y = 0.

E.4. Calculation of emission reductions or net anthropogenic removals

	Baseline GHG emissions or baseline net GHG removals (t CO ₂ e)	Project GHG emissions or actual net GHG removals (t CO ₂ e)	Leakage GHG emissions (t CO ₂ e)	GHG emission reductions or net anthropogenic GHG removals (t CO ₂ e)		
				Before 01/01/2013	From 01/01/2013	Total amount
Total	42,728	-	-	-	42,728	42,728

E.5. Comparison of emission reductions or net anthropogenic removals achieved with estimates in the registered PDD

Amount achieved during this monitoring period (t CO ₂ e)	Amount estimated ex ante (t CO ₂ e)

Amount achieved during this monitoring period (t CO ₂ e)	Amount estimated ex ante (t CO ₂ e)
42,728	55,245

E.6. Remarks on increase in achieved emission reductions

The actual emission reduction figures have been lower than projected in the PDD. This difference results from lower water levels than expected, as well as occasional JIRAMA line interruption and unavailability of the power plant during sand removal.